



TEST REPORT

Test Report



68, Gajaeul-ro, Seo-gu, Incheon, 22829, Korea TEL 82-41-589-0010 FAX 82-41-589-0012	Report No. : THF-2024-000013 1 / 9
--	---------------------------------------

1. Applicant

- Company Name : Saint-Gobain Isover Korea Co.,Ltd
- Address : F, 70, Bugokgongdan 1-gil, Songak-eup, Dangjin-si, Chungcheongnam-do, Republic of Korea
- Date of receipt : 20240109

2. Test target product

- Sample Name : WeatherProof FR(Yellow Tissue)
- Applied Range : Interior Finishing Materials
- Product No. : WeatherProof FR(Yellow Tissue)_231229

3. Test Standard : Ministry of Land, Infrastructure and Transport Notice No. 2023-24 'Quality recognition and management standards for building materials, etc.'

4. Purpose of the report : QUALITY CONTROL

5. Test period : 2024. 01. 09. ~ 2024. 02. 21.

6. Test Environment : Temperature : (15~30) °C, humidity : (20~80) % R.H.

7. Test Results : Suitable with test results according to Ministry of Land, Infrastructure and Transport Notice No. 2023-24 'Quality recognition and management standards for building materials, etc.' Article 23 Subparagraphs 1 and 2

- ①. The test results of this test report are only limited in to the samples and sample names provided by the client and do not guarantee the quality of all products of the client. You can check website (www.ktr.or.kr) or QR code to verify the authenticity of the certificate.
- ②. This test report shall be used only within the purpose of its defined usage and shall not be used for public relation, advertisement and lawsuit.
- ③. This test report is only valid when printed on KTR original report paper with hologram and when re-issued by KTR.

Confirm	Prepared by	Technical Manager
	Name :	Lee Seong-gyu u <i>Lee Seong-gyu</i>

Issue Date : 2024. 02. 21

Korea Testing & Research Institute

President *Kim Hyun cheol*



QR Code to verify genuineness

* Test reports are valid for 3 year from the date of issuance of the report.

8. Test Results

Division	Test Item	Unit	Test Results			Criteria	Test Method	Test Site	
			1st	2st	3st				
Interior and Exterior Finishing materials	Non-combustibility test	Mass reduction rate	%	6.3	4.7	6.0	30 % below	(1)	A
		The difference between maximum furnace temperature and final equilibrium temperature	K	2.6	5.7	3.5	20 K below		
	Hazardous Gas test	Average deed stopping time	min:s	14:31	14:45	-	more than 9 min		

- ※ Performance test was done according to the Article 23, (1) and (2) of the 「Ministry of Land, Transport and Maritime Affairs, Notification No. 2023-24」.(Client provided)
- ※ Suitable to Non-combustibility test result according to Article 23, (1) of 「Notice No. 2023-24 of the Ministry of Land, Infrastructure and Transport」.
- ※ Suitable to gas hazard test results according to Article 23 (2) of 「Notification No. 2023-24 of the Ministry of Land, Infrastructure and Transport」.
- ※ Test reports are valid for three years from the date of issuance of the report according to the Article 29, (4) of the 「Ministry of Land, Transport and Maritime Affairs, Notification No. 2023-24」.
- ※ Test Method
 - (1) 「Ministry of Land, Infrastructure and Transport Notice No. 2023-24」
- ※ Test site A. Korea Testing & Research Institute Building C, 68, Gajaeul-ro, Seo-gu, Incheon, Republic of Korea
- ※ Non-combustible materials performance criteria in the Article 23(1) and (2) of the 「Ministry of Land, Transport and Maritime Affairs, Notification No. 2023-24」.
 - 1) After heating, the mass reduction rate of the specimen must be 30% or less
 - 2) The maximum temperature in the heating furnace should not rise by more than 20K over the final equilibrium temperature for 20 minutes after the start of heating.
 - 3) The average time of suspension of behavior in experimental mice should be more than 9 minutes.



Certificate No : THF-2024-000013

쪽 (3) / 총 (9)

■ Test conditions for Non-combustibility test


	Date of Test	2024. 01. 25.
Testing Environment	Temperature (23 ± 2) °C, Relative Humidity (50 ± 5) % R.H.	
Test Time (min)	20	

■ Non-combustibility test conditions




Diameter (mm)	No. 1	44.8	No. 2	45.0	No. 3	44.9
Height (mm)		50.0		50.0		50.0
Initial mass (g)		4.0		4.0		4.0
Final mass (g)		3.7		3.8		3.7
Maximum furnace temperature (°C)		775.0/773.0		774.0/772.0		770.0/768.0
Final equilibrium temperature (°C)		772.3/770.5		768.2/766.3		766.7/764.4
The difference between maximum furnace temperature and final equilibrium temperature (K)		2.6		5.7		3.5
Total density (kg/m ³)		50.3		50.6		50.4
Core density (kg/m ³)		-		-		-
Pretreatment		Temperature (23 ± 2) °C, Relative Humidity (50 ± 5) % R.H.				

■ Composition of specimen

Composition	Quality of the material	Manufacturer	Model	Thickness (mm)
Insulation	Glasswool	Isover korea	WeatherProof FR (Tellow Tissue)	50 mm

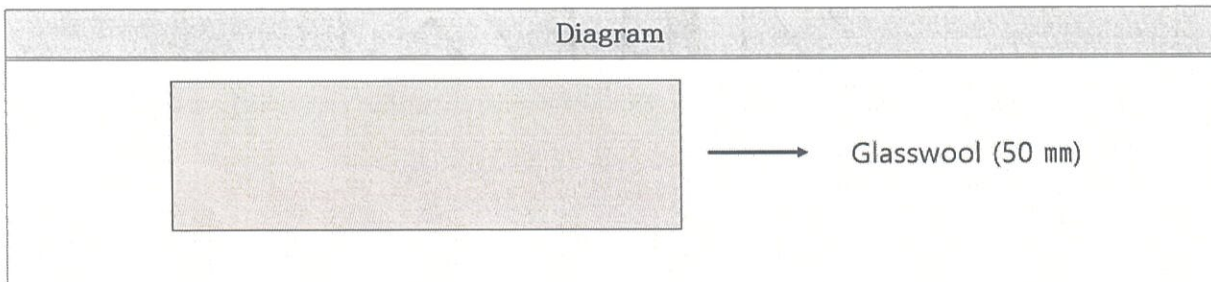

■ Non-combustibility test Temperature Graph

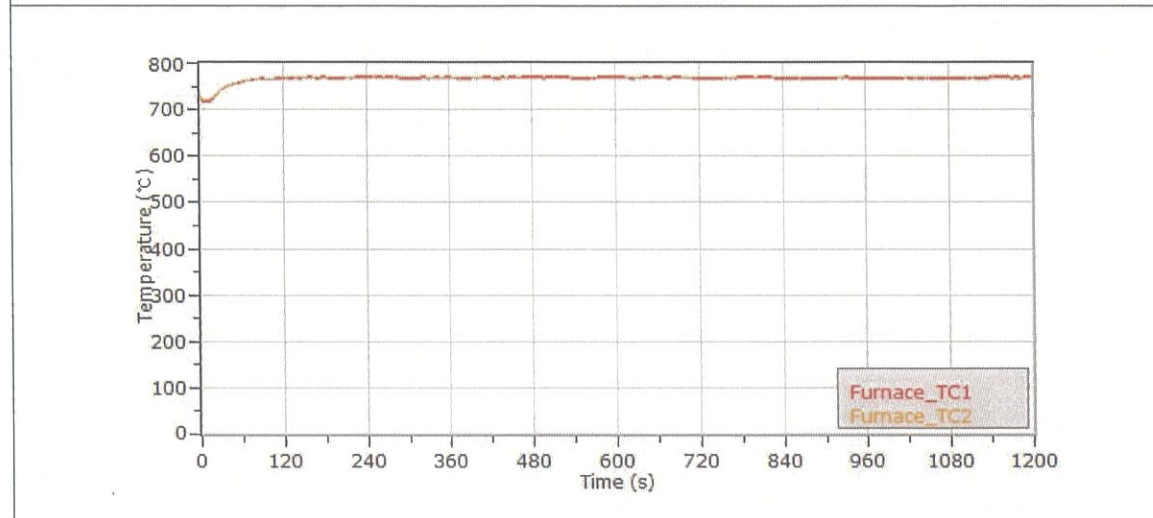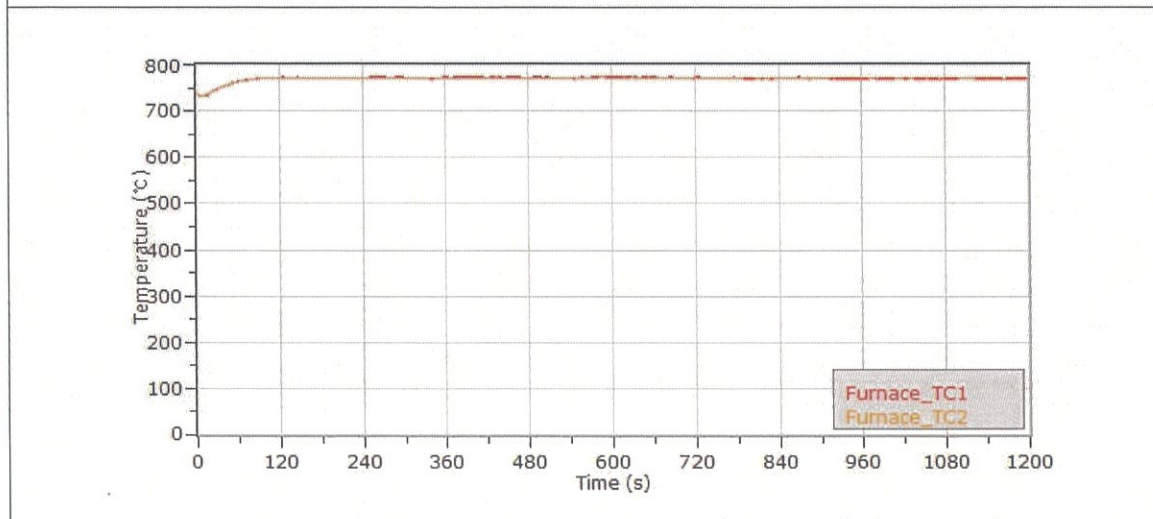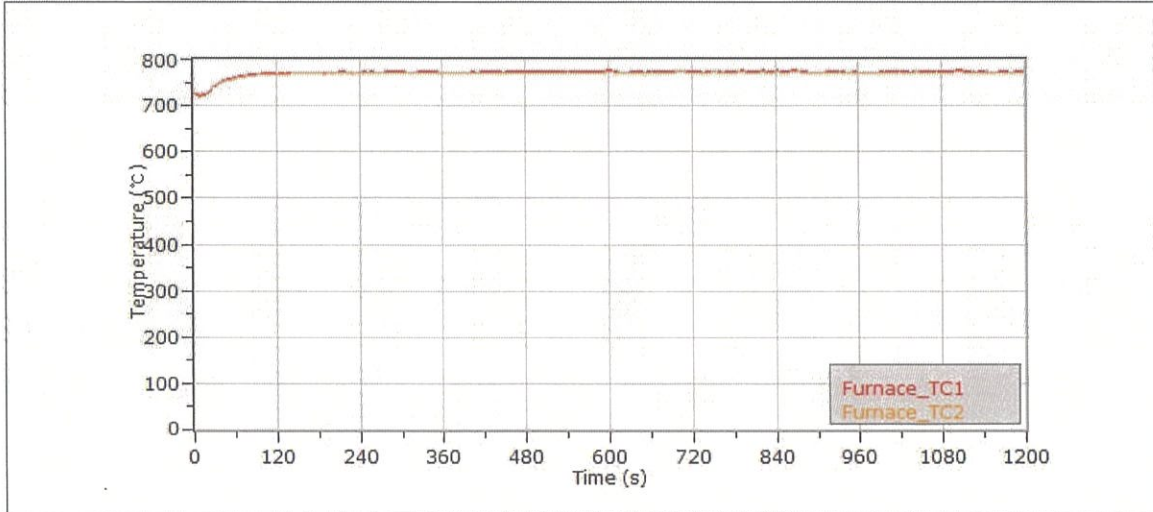

■ Gas Hazard test result

Test Items	Unit	Test result		Test Method
		No. 1	No. 2	
Average deed stopping time of Test Mouse	min:s	14:31	14:45	(1)

Date of Test	2024. 01. 26.
--------------	---------------

■ Gas Hazard Test Conditions

Heating Condition	After heating for 6 minutes with auxiliary heat source (LPG), heat again for 3 minutes with main heat source (electric heat)				
Burning surface (Client provided)	Separate display of Burning surface				
Testing Environment	Temperature (23 ± 2) °C, Relative Humidity (50 ± 5) % R.H.				
Test Time (min)	15				
Test Mouse	Line	ICR, Female	Age	5	Weight (18 ~ 22) g

■ Gas Hazard Test Specimen Conditions

	No. 1	No. 2
Width (mm)	218.2	218.1
Length (mm)	218.1	219.4
Thickness (mm)	48.3	48.8
Mass (g)	95.3	106.5
Total density (kg/m ³)	42.7	47.0
Pretreatment	Temperature (23 ± 2) °C, Relative Humidity (50 ± 5) % R.H.	

■ Report on the end of animal testing

Committee approval number	IAC2024-0153
Committee approval date	2024-01-12




■ Standard Form Test

- Standard Form : Fiber Reinforced Calcium Silicate Board

< Exhaust Temperature >

Elapsed Time (s)	Standard Temperature (°C)	Measure Temperature (°C)	Temperature range (°C)
0.0	30	31.6	-1.6
60.0	70	69.0	1.0
120.0	85	86.6	-1.6
180.0	100	99.5	0.5
240.0	140	145.1	-5.1
300.0	170	173.1	-3.1
360.0	195	189.4	5.6



< Exhaust Temperature Curve >

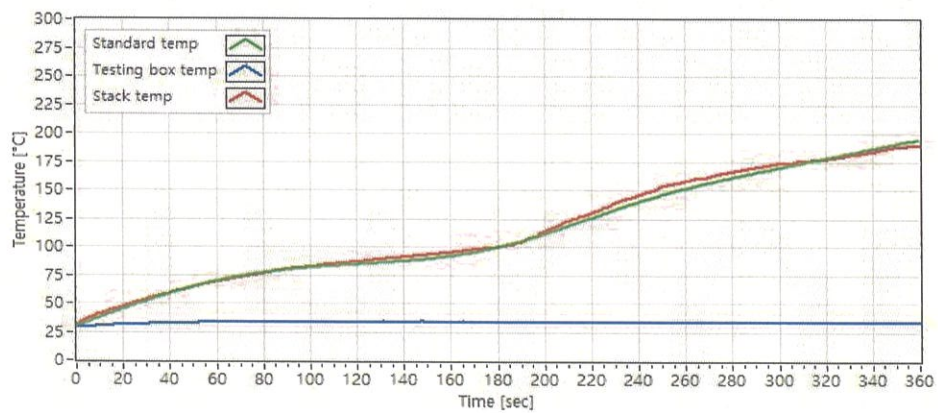

■ Hazardous gas test result(No. 1)

Elapsed Time (s)	Measure Temperature (°C)
0	29.9
60	86.6
120	104.6
180	118.7
240	172.0
300	208.1
360	230.0



Spinning box	Stop time
M1	15 min 00 s
M2	14 min 24 s
M3	15 min 00 s
M4	14 min 22 s
M5	15 min 00 s
M6	14 min 44 s
M7	15 min 00 s
M8	15 min 00 s
Average	14 min 48 s
Standard deviation	00 min 17 s
Average deed stopping time	14 min 31 s

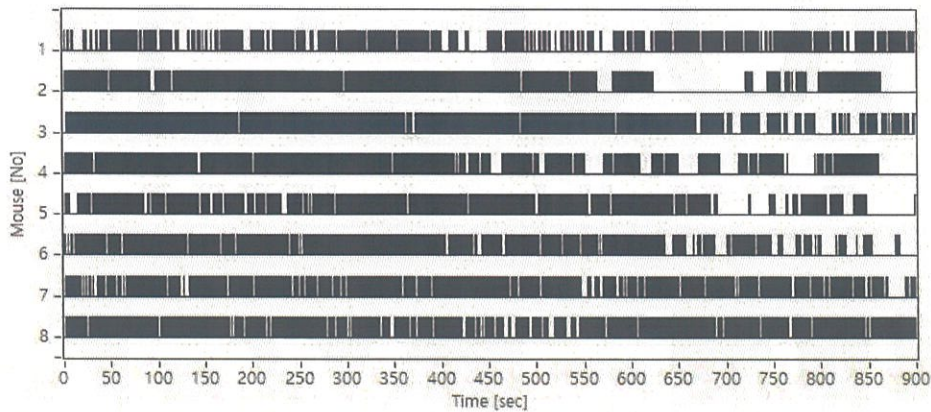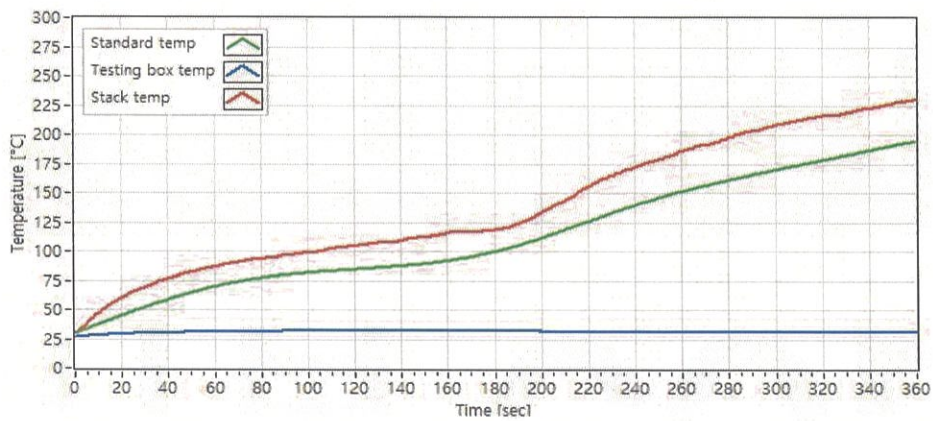

■ Hazardous gas test result(No. 2)

Elapsed Time (s)	Measure Temperature (°C)
0	32.3
60	76.5
120	97.1
180	109.5
240	150.2
300	187.3
360	219.0

Spinning box	Stop time
M1	14 min 51 s
M2	15 min 00 s
M3	15 min 00 s
M4	15 min 00 s
M5	15 min 00 s
M6	14 min 59 s
M7	15 min 00 s
M8	14 min 34 s
Average	14 min 55 s
Standard deviation	00 min 10 s
Average deed stopping time	14 min 45 s

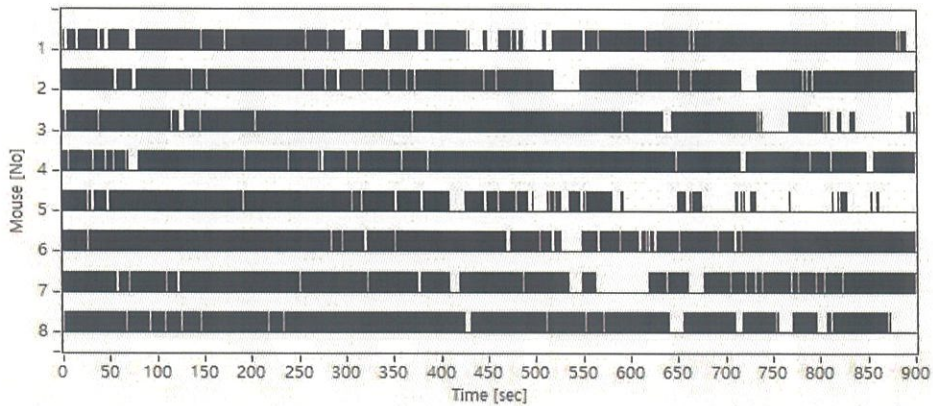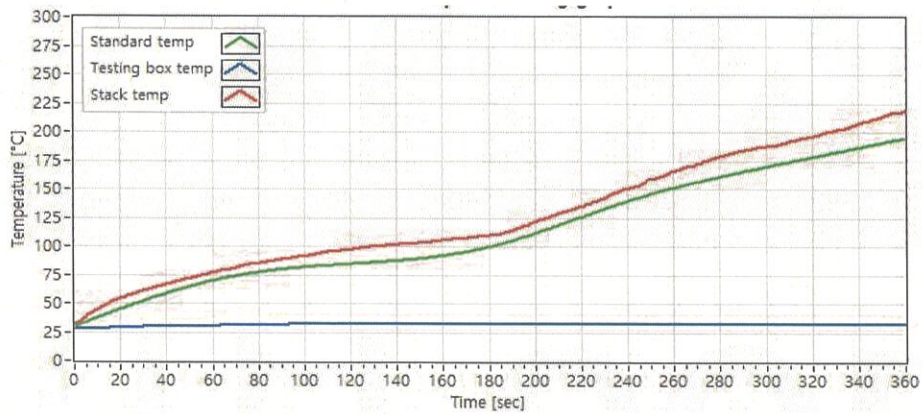


■ Test sample picture

< Non-combustibility test >



< Gas Hazard Test >

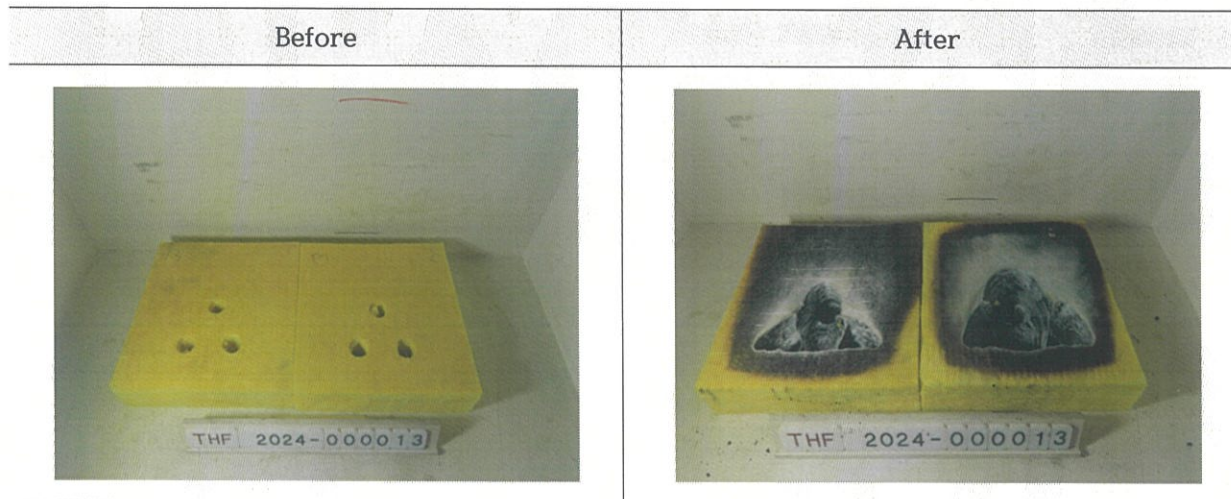

----- End -----